


IDE3-150-D480




Installation

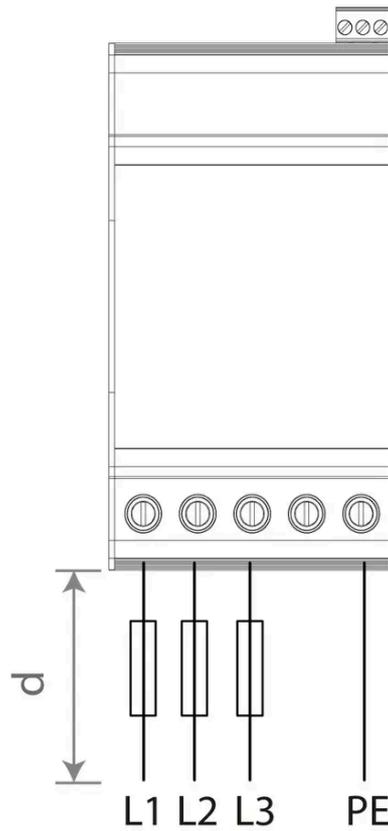

Before starting installation check the connection wires, if there are 3 wires and an earth you have the correct SPD, if there are 4 wires with a neutral and an earth then it is not the correct SPD. Consult the Novaris product handbook or contact your local distributor for more information.

$$d + d \leq 0.5m$$

Alarm




11-12 open	Power On
11-14 closed	
11-12 closed	Power Off
11-14 open	

Terminals

Terminal Type		
min Capacity	2.5 mm ²	0.5 mm ²
max Capacity	16 mm ²	2.5 mm ²
Torque	2 Nm	0.6 Nm
Strip Length		

Mounting Information

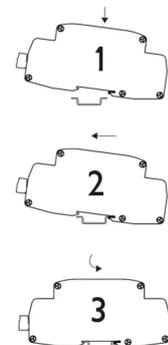

Electrical Specifications

Connection type		Shunt
Nominal voltage	U_0	400VAC
Maximum backup fuse		80A
Recommended SCB		SCB1-3-25
Earth leakage current	I_{PE}	<10µA

Mechanical Specifications

Minimum operating temperature		-40°C
Maximum operating temperature		70°C
Minimum operating humidity		5%
Maximum operating humidity		95%
Mounting method		TS35 DIN Rail